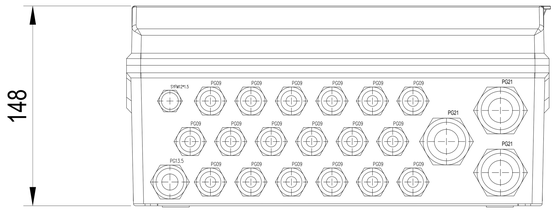

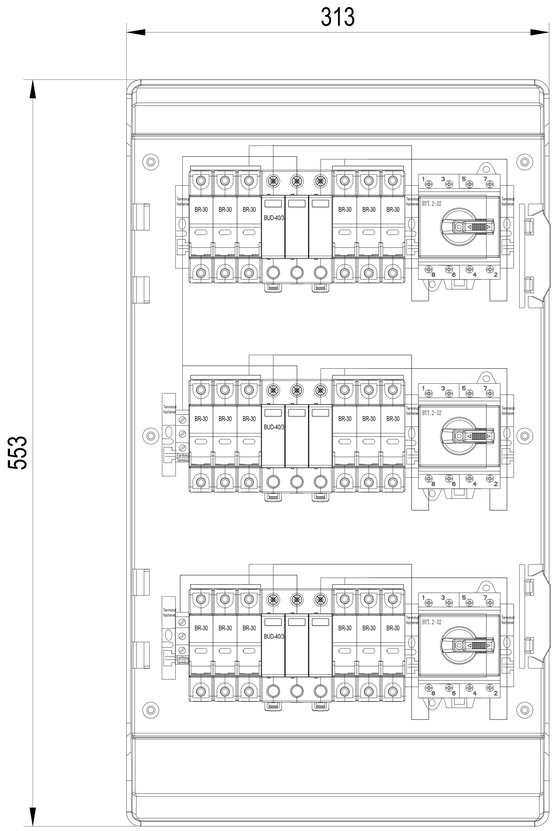

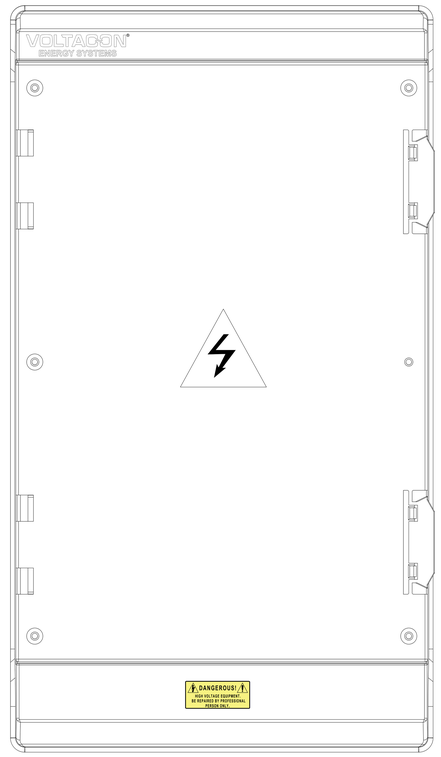

number	label	The name of the	specifications	quantity	note
4		Vent valve	SYFM12*1.5	1	
3		CABLE GLAND	PG21 SEALING RANGE 13-18mm	3	
2		CABLE GLAND	PG13.5 SEALING RANGE 6.7-12mm	1	
1		CABLE GLAND	PG09 SEALING RANGE 4-8mm	18	

The contract no					Tank no	Factory number	
tag		Change the file no	The signature	The date of	BHS-9/3 PV COMBINER BOX	Pattern marker	The proportion
design		standardized			Arrangement diagram		
drawing		Review and approval					
check		approval					
process		The date of				VOLTACON ENERGY SYSTEMS UK	

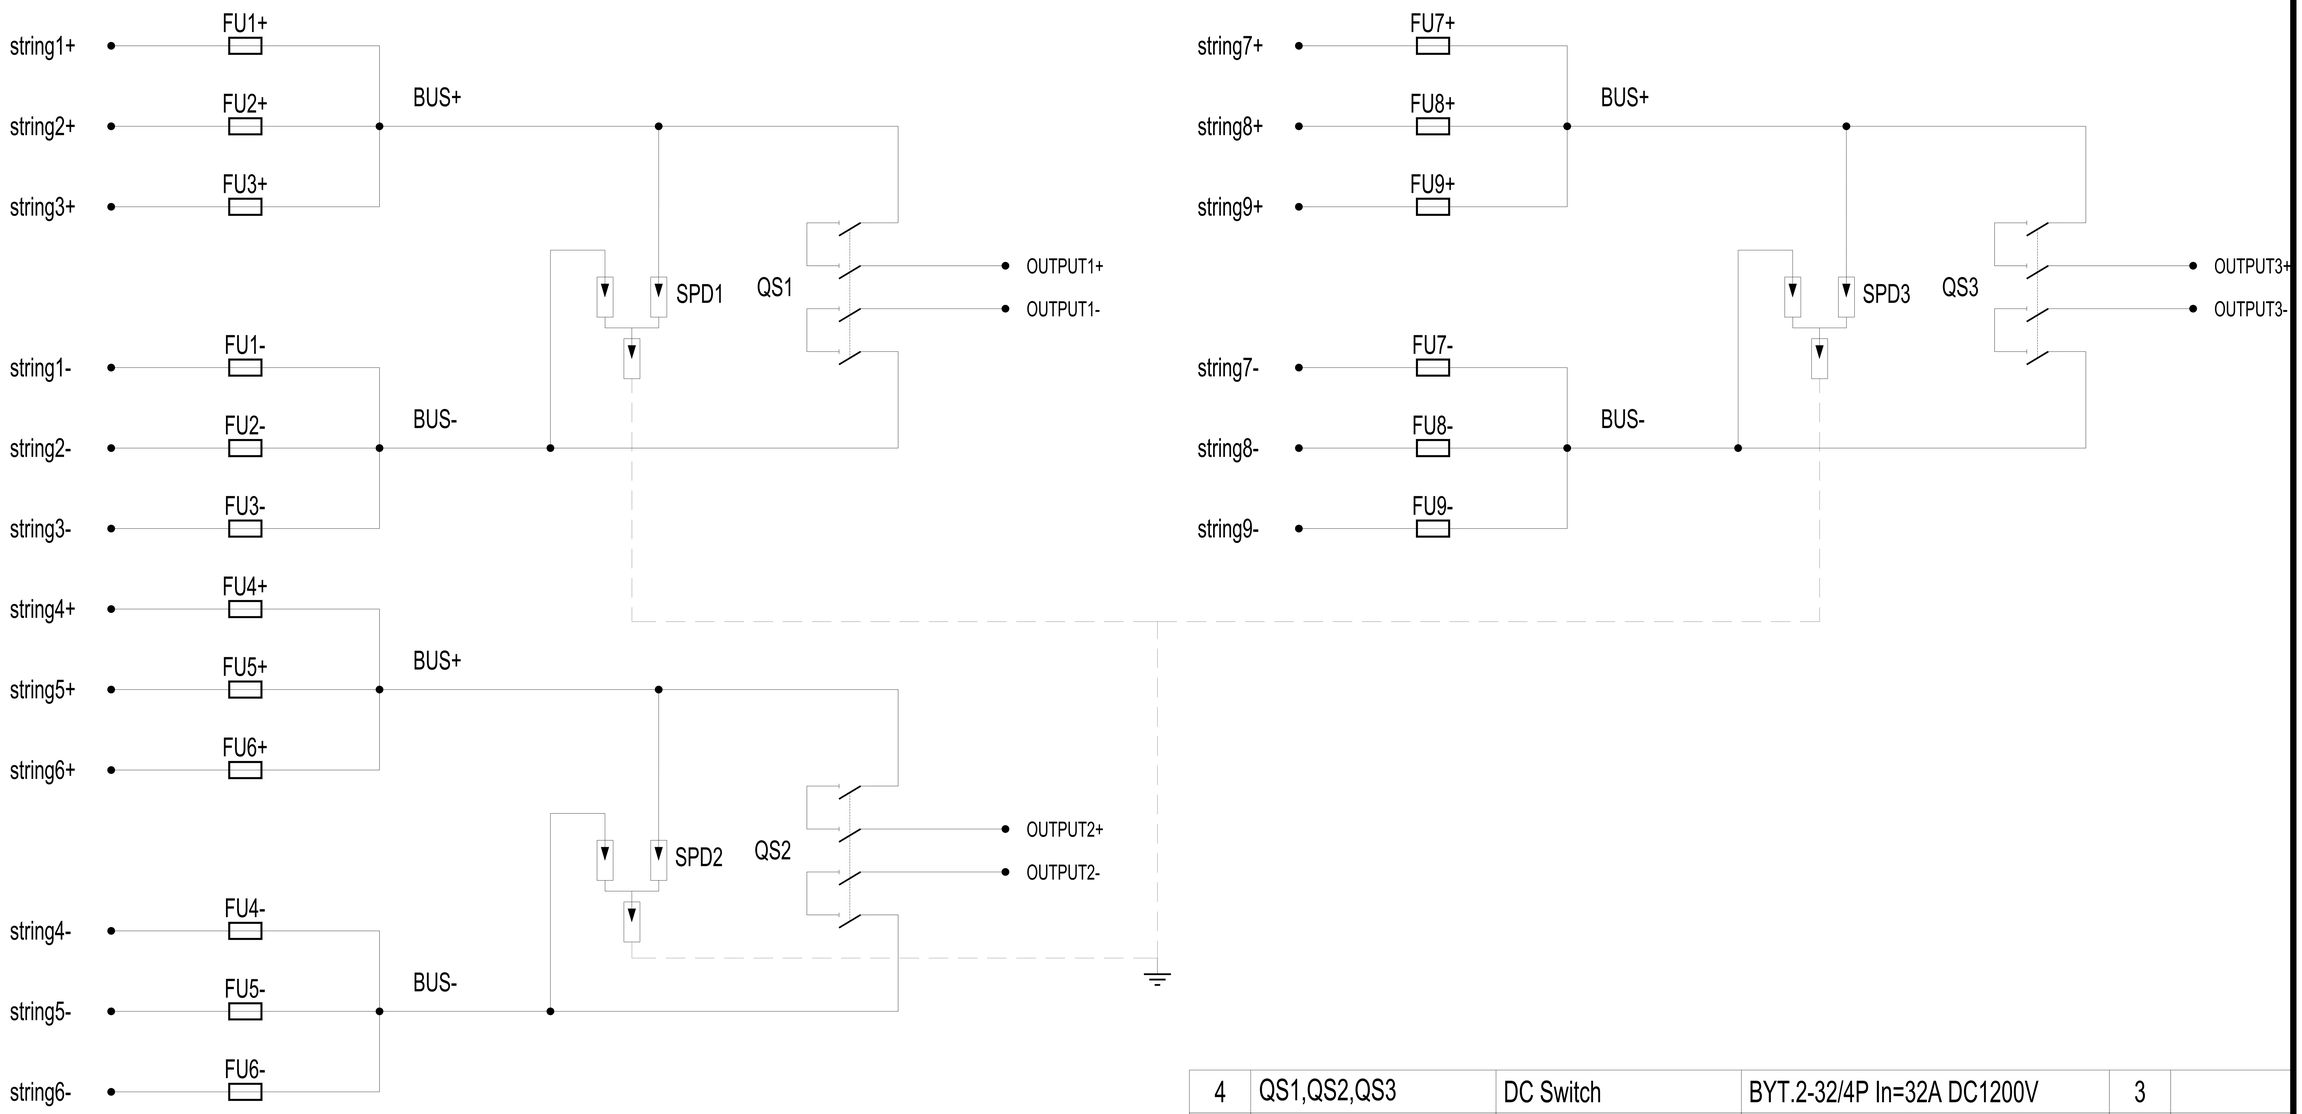

number	label	The name of the	specifications	quantity	note
4	QS1,QS2,QS3	DC Switch	BYT.2-32/4P In=32A DC1200V	3	
3	SPD1,SPD2,SPD3	DC SPD	BUD-40KA/3P DC1000V	3	
2		DC Fuse Link	OSPV-30 12A DC1000V gPV	18	
1	FU	DC Fuse Holder	BR-30/1P 30A DC1000V	18	

The contract no					Tank no	Factory number	
tag		Change the file no	The signature	The date of	BHS-9/3 PV COMBINER BOX	Pattern marker	The proportion
design		standardized			Schematic diagram		
drawing		Review and approval					
check		approval					
process		The date of				VOLTACON ENERGY SYSTEMS - UK	